

# Fuel Tank Advisory Committee (FTAC) Meeting




## Drinking Water Investigation



# Overview of Low-Level TPH Detections

SAFE. DELIBERATE. ENGAGED. COMMITTED.

**Total TPH Detection Frequency by LTM Period  
(March 2022 - February 2024)**

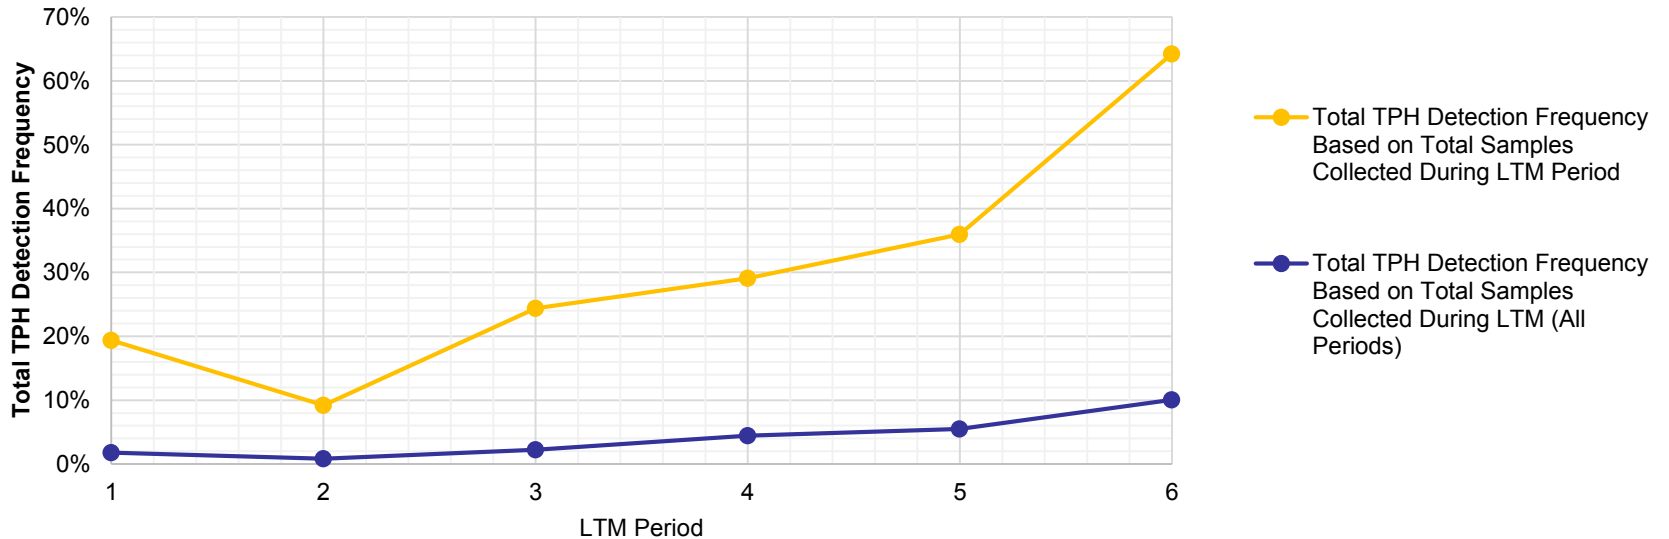


LTM Period	Number of Samples	Number of Total TPH Detects	Total TPH Detection Frequency (Based on Number of Samples Collected During Current LTM Period)	Total TPH Detection Frequency (Based on Total Number of Samples Collected During All LTM Periods)	Average Detected Concentration
Period 1 (Month 1)	897	174	19%	1.8%	65 ug/L
Period 2 (Month 2)	892	85	9.2%	0.84%	63 ug/L
Period 3 (Month 3)	886	216	24%	2.2%	67 ug/L
Period 4 (Month 4)	1,492	434	29%	4.5%	65 ug/L
Period 5 (Month 10)	1,490	536	36%	5.5%	67 ug/L
Period 6 (Month 16)	1,522	977	64%	10%	80 ug/L



# Low-Level TPH Detections: MDL/MRL

SAFE. DELIBERATE. ENGAGED. COMMITTED.

- Majority of TPH detections under LTM between 50-80 ppb
  - Between MDL and MRL\*
  - \*MDL > Results < MRL are estimates, not reliably quantified

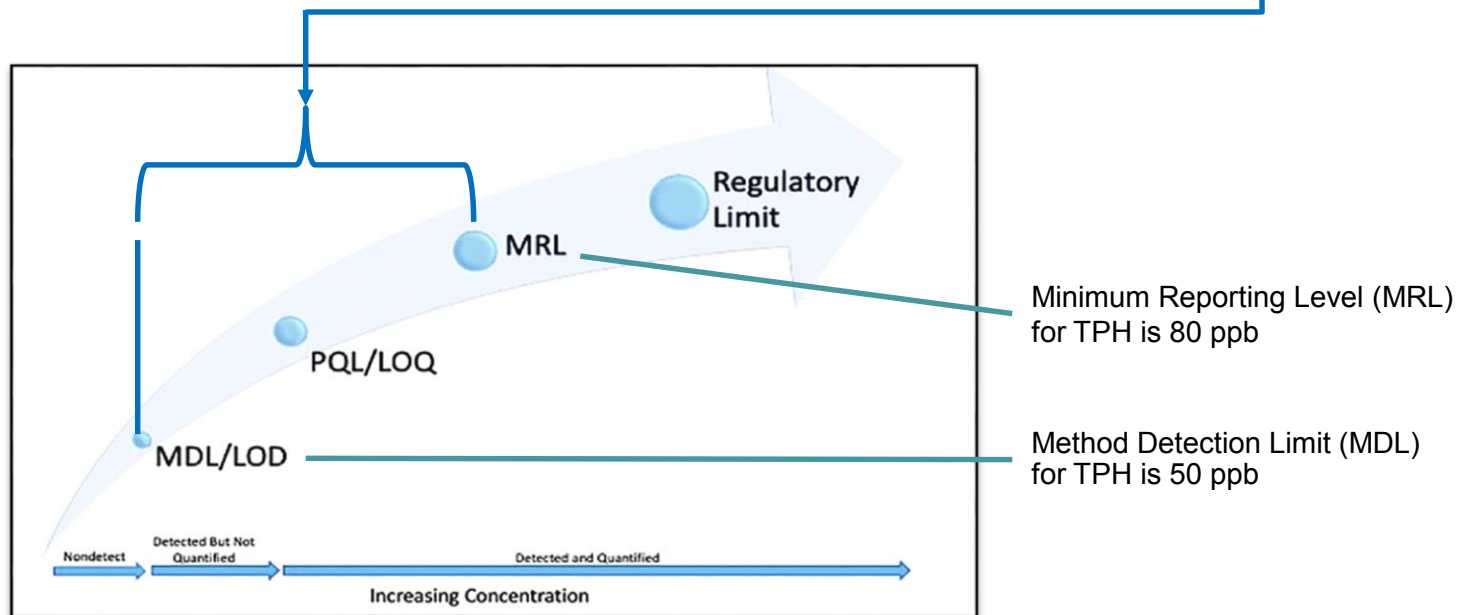

- Higher level of detection (>150 ppb) provides improved reliability that TPH can be accurately quantified



# Low-Level TPH Detections: Spatial Evaluation

SAFE. DELIBERATE. ENGAGED. COMMITTED.

## Important Notes/Context When Reviewing the Following Figures:

- All TPH detections are below Incident Specific Parameter (ISP) of 266 ppb
- Majority of TPH detections were between 50-80 ppb\*
  - \*Between the MDL and MRL, not reliably quantified
  - Pushing Method 8015 to its limits
- Similar trends among all 19 JBPHH sampling zones
  - TPH detections are not clustered in one area
  - TPH detections are bracketed by non-detects
- Similar TPH detections/trends were observed in Zones that did not receive drinking water from Red Hill during the November 2021 Red Hill Release:
  - A1 (Pearl City Peninsula), A2 (Ford Island), B1 (McGrew/Halawa), and G1 (Camp Smith)
- Similar TPH detections/trends were observed in Zones protected by Granular Activated Carbon (GAC) filters, which will remove all organics (including TPH):
  - H1, H2, H3 (Aliamanu Military Reservation) and I1 (Red Hill)



LTM Period 5 – Dec 2022 to Jun 2023

SAFE. DELIBERATE. ENGAGED. COMMITTED.

# Under Development



LTM Period 6 – Jun 2023 to Nov 2023

Under Development



## LTM Period 6 – Jun 2023 to Nov 2023

SAFE. DELIBERATE. ENGAGED. COMMITTED.

# Under Development



# Consumer Complaints/Concerns

SAFE. DELIBERATE. ENGAGED. COMMITTED.

- Increasing amount of low-level TPH detections during recent LTM Period
- Higher volume of EOC calls and residential complaints starting September 2023
- Established “SWARM” Team of DW Experts (01/29/2024)
  - Navy, EPA, DOH, DHA, and technical experts
  - **Determine root cause of low-level detections of TPHs in JBPHH water system**
- The Navy is committed to engaging with the community through events like Town Halls, CRI, Fuel Tank Advisory Committee meetings, and other events to share information
  - Developing fact sheets and informational packets to keep residents informed

Month	No. EOC Calls	Samples Collected
Sept 2023	35	1
Oct 2023	41	16
Nov 2023	9	7
Dec 2023	10	6
Jan 2024	28	24
Feb 2024	19	17
Total	142	71

Notes: EOC calls also include inquiries and sample requests. Not all EOC calls are water complaints.



The Navy recognizes the significance of potential health and safety concerns and takes these issues very seriously.



# LTM – TPH Detections: Root Cause Analysis

SAFE. DELIBERATE. ENGAGED. COMMITTED.

- Jan 29, convened Interagency Team of DW Experts from across the country (Navy, EPA, DOH, DHA, and private Industry)
- Below is the Interagency Team’s assessment of how likely the potential root cause is related to/responsible for the increase in frequency of low-level TPH detections that have been observed during LTM:
  - **Laboratory Method Challenges – High Likelihood.**
  - TPH in the Waiawa Source Water – *Extremely Low Likelihood.*
  - Regulated Disinfection Byproducts – *Low Likelihood.*
  - Residual JP-5 in Distribution System – *Extremely Low Likelihood.*
  - Residual Fuel Additives in Distribution System – *Extremely Low Likelihood.*
  - Biofilm Activity – *Medium/Low Likelihood.*
  - Premise Plumbing – *Low Likelihood.*
  - Pipe Scale Sloughing – *Low Likelihood.*
  - Pesticides – *Extremely Low Likelihood.*
  - Change in System Operations – *Extremely Low Likelihood.*
  - Change in Source Water (Waiawa Shaft) Water Quality – *Extremely Low Likelihood.*
  - Contaminant / Debris Introduced During Water Main Breaks – *Extremely Low Likelihood.*
  - Other – *Unknown Likelihood.*



# LTM – TPH Detections: Hypothesis

SAFE. DELIBERATE. ENGAGED. COMMITTED.

**Hypothesis:** Low-level detections of TPH observed during LTM are most likely associated with:

- Laboratory challenges to quantify TPH to the Method Detection Limit
  - Method blank contamination/laboratory cross-contamination
- Method challenges
  - Interaction of residual chlorine in the drinking water samples with reagents required by the method to analyze the samples

## **Supporting Lines of Evidence<sup>1</sup>:**

- Spatial and Temporal Trends of TPH Results
- Hydraulic Modeling of the JBPHH Drinking Water System
- **Detailed Review of the Analytical Methods Used to Identify and Quantify TPH**
- Statistical Analysis of Chlorine Residual




<sup>1</sup>Will be documented in Tech Memo (currently being developed).



# LTM – TPH Detections: Lines of Evidence

SAFE. DELIBERATE. ENGAGED. COMMITTED.

## A Little Chemistry: Chromatograms Showing Gasoline and Diesel

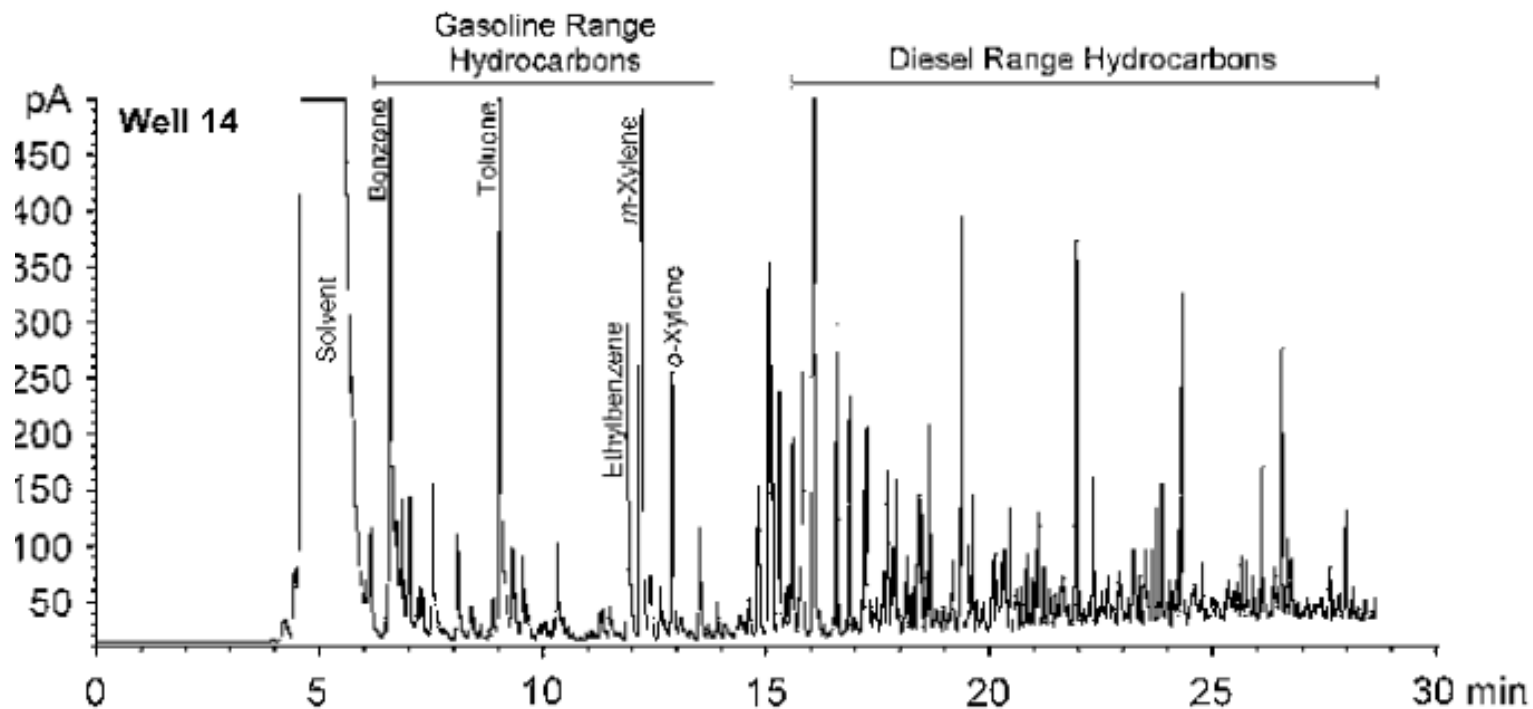

Note: There have been no petroleum patterns in the chromatograms that match JP-5 or other petroleum products in drinking water samples collected under the LTM Program.



# LTM – TPH Detections: Lines of Evidence

SAFE. DELIBERATE. ENGAGED. COMMITTED.

## A Little Chemistry: Impact of Quenching to Prevent Chlorine Reactions

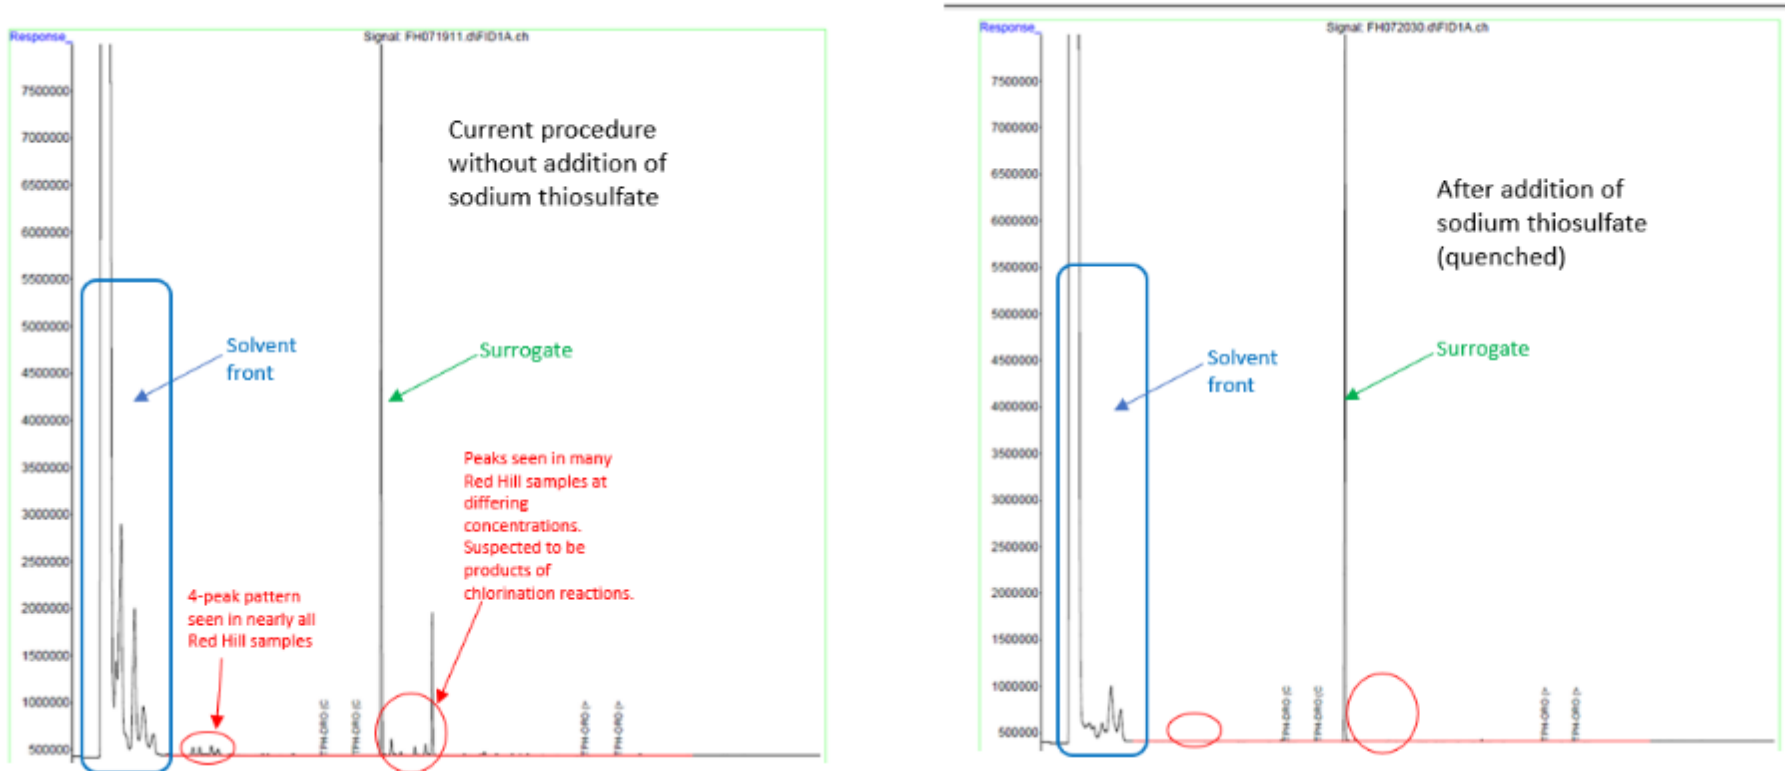


Figure C-1. Effect of Sodium Thiosulfate Addition (Quenching) Sample H3-TW-0013887-23335-A



# LTM – TPH Detections: Lines of Evidence

SAFE. DELIBERATE. ENGAGED. COMMITTED.

## A Little Chemistry: Impact of Quenching to Prevent Chlorine Reactions


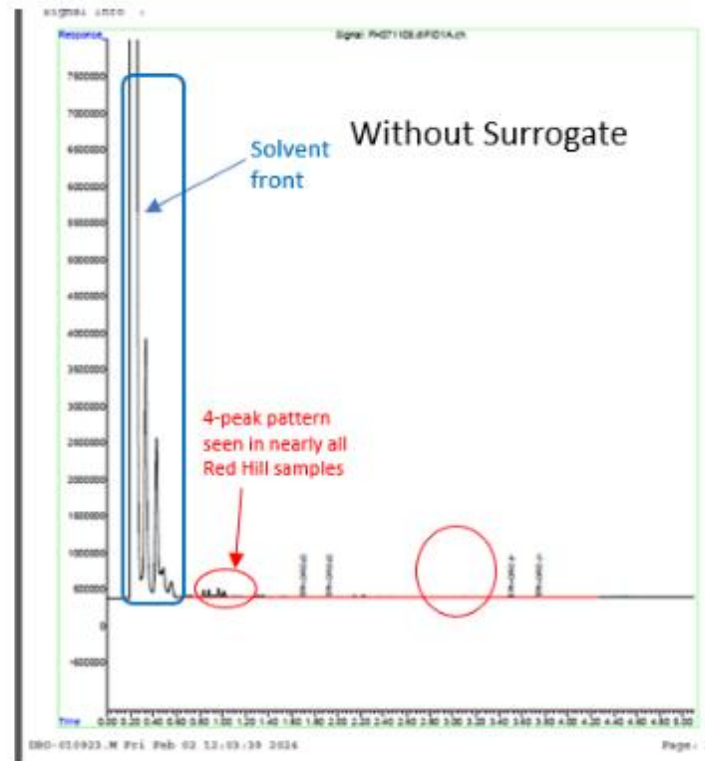


Figure C-2. Surrogate Contribution of Precursors to Halogenation Reaction Sample F2-TW-0009845-23335-N

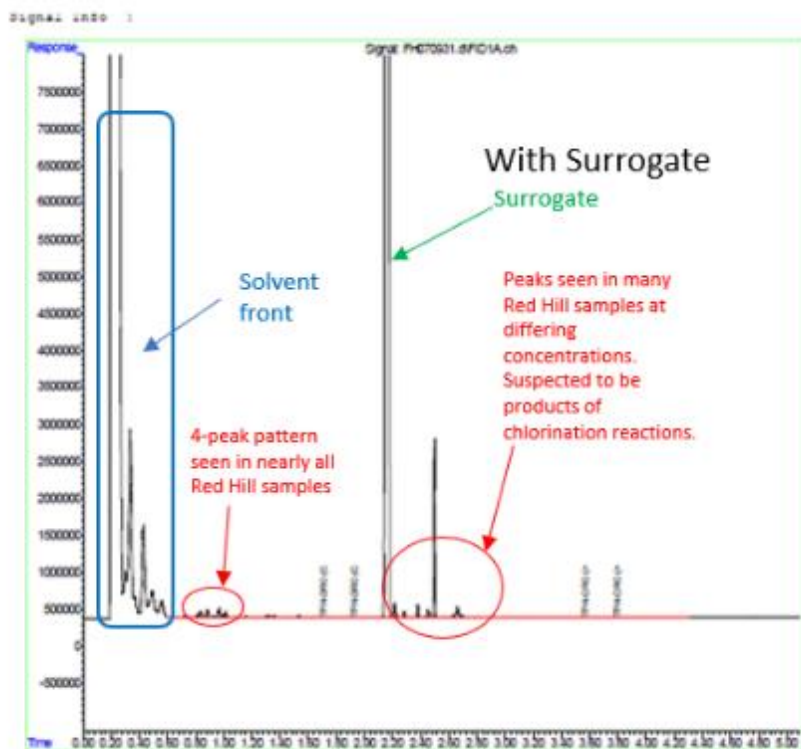

# LTM – TPH Detections: Lines of Evidence

SAFE. DELIBERATE. ENGAGED. COMMITTED.

## A Little Chemistry: Any Petroleum Signatures Observed?

- There were no petroleum signatures observed in any of the samples examined
- The only unknown peaks in any of the samples were found to be:
  - Fatty acids (naturally occurring in Fats [Lipids])
    - Similar to hydrocarbons (can have short, long, and very long chains) but also have oxygen atoms (C-O-H)
    - Are not petrogenic hydrocarbons but will appear as TPH in Method 8015 results
  - Phthalates (used in plastics – very, very common in laboratories and the environment)
    - Are not petrogenic hydrocarbons but will appear as TPH in Method 8015 results



# Extended Drinking Water Monitoring (EDWM)

SAFE. DELIBERATE. ENGAGED. COMMITTED.


- The Navy agreed to voluntary effort to extend monitoring past Long Term Monitoring – EDWM program
  - Original 19 sampling zones + Manana housing (20 zones total)
  - Focus on JP-5 related analytes
  - New analytical method for TPHs – reduce impact from residual chlorine and reduce impact of cross contamination in the lab
  - Sampling will take place monthly for 1 year
  - Results will be posted to Safe Waters and documented in Quarterly Reports
- Goals:
  - Sample Remaining residences on JBPHH water system (~35% have not been sampled)
  - Continue to monitor the JBPHH system to ensure there are no impacts from the 2021 Red Hill release





# Actions Taken by Navy

SAFE. DELIBERATE. ENGAGED. COMMITTED.

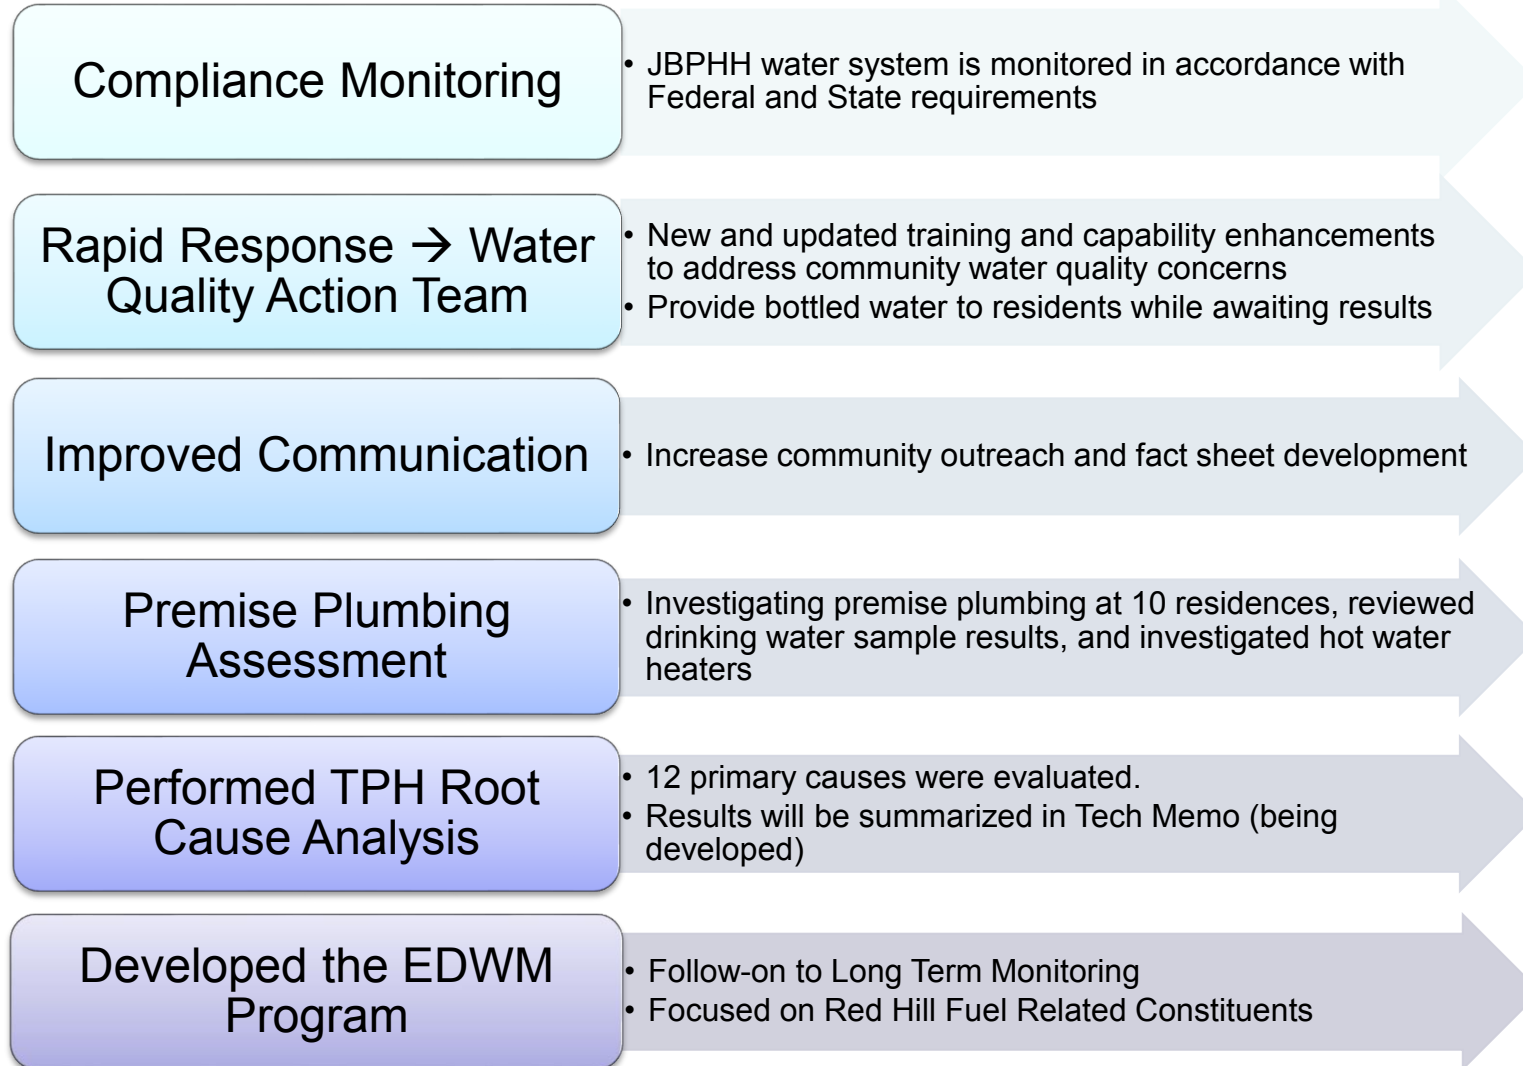

**Actions Taken By Navy**



# JBPHH Water Quality Plan

SAFE. DELIBERATE. ENGAGED. COMMITTED.

Continue to Ensure JBPHH Drinking Water is Safe by Meeting State and Federal Standards

## EDWM is one piece of the overall effort

### Keys to this Plan:

- Continuing Safe Drinking Water Act Compliance Monitoring.
- Extend Drinking Water Monitoring with Focus on JP-5 Related Analytes to continue to ensure there are no impacts from the 2021 Red Hill release.
- Continue Rapid Response Team actions with capability enhancements to further address water quality concerns – Water Quality Action Team



# JOINT BASE PEARL HARBOR-HICKAM DRINKING WATER PROGRAM

## ENSURING SAFE AND COMPLIANT DRINKING WATER



### Water Quality Action Team

- 24/7 Response to Consumer Concerns through Emergency Operations Center
- Full Water Quality evaluation for consumer concerns, includes Water Quality Professional
- Includes investigations of hydrocarbons, bacteria, residual chlorine, water heater, and plumbing concerns



### Compliance Monitoring

- Recurring monitoring in accordance with the Safe Drinking Water Act for all Drinking Water Systems
- Full Drinking Water analytes sampled for plus required operational testing (bacteria/chlorine/etc.)
- Reported to all consumers by the JBPHH Consumer Confidence Report which is completed each summer



### Extended Drinking Water Monitoring Program

- Follow-on to Long Term Monitoring Program, will be conducted for an additional 12 months
- Focus of the monitoring will be on petroleum hydrocarbon and fuel-related constituents



### Drinking Water System Operations and Maintenance

- Source Water and Wellhead Protection Plan
- Unidirectional Flushing
- Backflow and Cross Connection Program



### Medical Monitoring

- Established Red Hill Clinic and authorizing eligible community members to use the clinic
- Established Defense Occupational and Environmental Health Readiness Red Hill Incident Report
- Ongoing CDC/ATSDR Public Health Assessment and establishing Red Hill Registry
- Epidemiological Studies and Medical Record Reviews



NAVY CLOSURE TASK FORCE  
FOR RED HILL



JBPHH

